



Submittal Data Sheet

Series Name:SAJA SERIES

Job Name _____ Location _____ Date _____
 Purchaser _____ Engineer _____
 Submitted to _____ For Reference Approval Construction
 Unit Designation _____ Schedule # _____

AHRI No: 216011720



CONFORMS TO
UL STD 1995
CERTIFIED TO
CSA STD C22.2
NO. 236





Specifications

Specifications				
Model				
Indoor Unit				ISA32341
Outdoor Unit				OSA32341
Cooling	Capacity	Rated	Btu/h	34000
	Capacity Range	Min-Max	Btu/h	/
	Power Input	Rated	W	3700
	Operating Range	°F		/
Heating	Capacity at 47F	Rated	Btu/h	24000
	Capacity Range	Min-Max	Btu/h	60.8-89.6F(16-32°C)
	Power Input at 47F	Rated	W	/
	Capacity at 17F	Rated	Btu/h	20000
	Capacity at 5F	Max	Btu/h	5200
	Capacity at -5°F	Max	Btu/h	/
	Operating Range	°F		50-89.6°F(10-32C)
Efficiency	SEER2			17
	HSPF2			8
Indoor Unit	Air Flow Rate(SH/H/M/L/Q)		CFM	941
	Sound Pressure Level	Cooling	dB(A)	52/49/46/41/33
		Heating	dB(A)	51/46/42/38/38
	Package Dimensions	H	In.[mm]	17.52[445]
		W	In.[mm]	52.76[1340]
		D	In.[mm]	13.98[355]
	Net Dimensions	H	In.[mm]	14.09[358]
W		In.[mm]	49.21[1250]	
D		In.[mm]	9.96[253]	

	Net Weight	lbs[kg]		35.27[16]
Outdoor Unit	Package Dimensions	H	In.[mm]	30.31[770]
		W	In.[mm]	40.16[1020]
		D	In.[mm]	16.93[430]
	Net Dimensions	H	In.[mm]	27.56[700]
		W	In.[mm]	35.04[890]
		D	In.[mm]	13.98[355]
	Net Weight	lbs[kg]		101.41[46]
Sound Pressure Level	Cooling	dB(A)	58	
	Heating	dB(A)	58	
Piping	Diameter	Gas(O.D.)	In.[mm]	15.88[5/8]
		Liquid(O.D.)	In.[mm]	6.35[1/4]
		Indoor Drain	In.[mm]	/
	Min.Length	ft [m]		/
	Max.Length	ft [m]		/
	Max.Height	ft [m]		/
Electrical	Outdoor-Indoor	V,ph,Hz		208-230V~/60Hz
	Recommended Breaker Size	A		/
	MCA	A		15.5A
	MOCP	A		/
Refrigerant	Refrigerant Type			R32
	Pre-Charge Amount oz			70.55oz
	Additional Charge Per Foot over 25ft			0.258oz/ft

Dimensions

Indoor Unit:
ISA32341

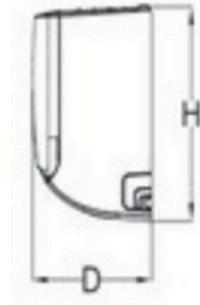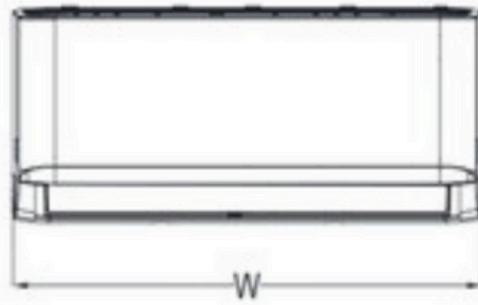


H	In	14.09
W	In	49.21
D	In	9.96




Dimensions

Outdoor Unit:
OSA32341

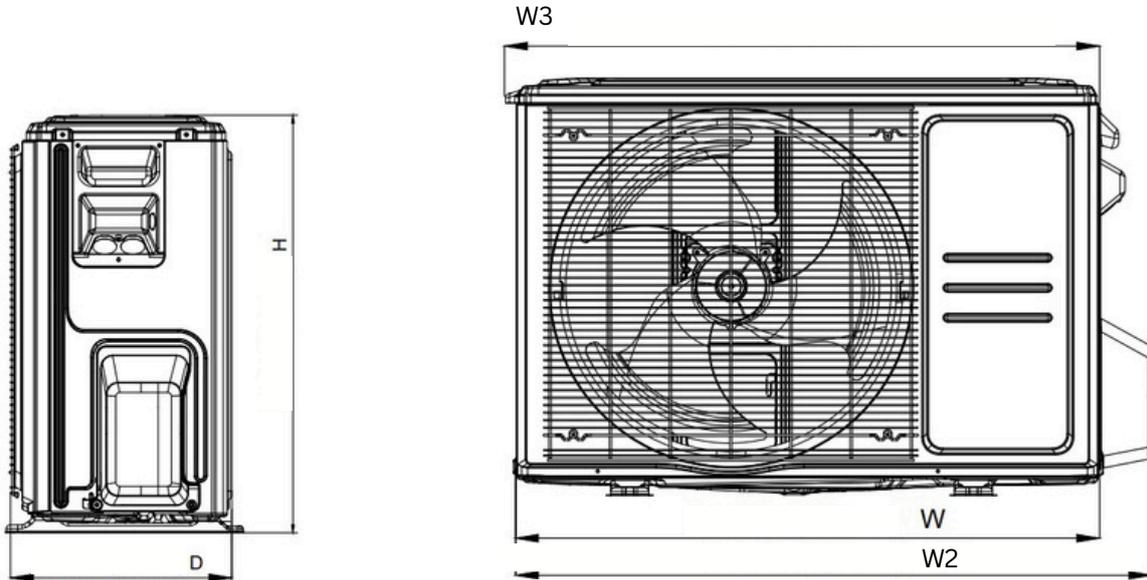

H	In	27.56
W	In	35.04
D	In	13.98
W2	In	38.54
W3	In	36.04

Installation Instruction

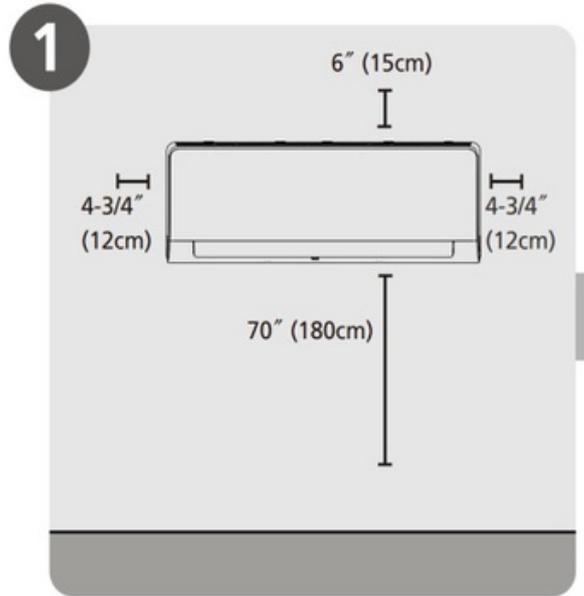

Select Installation Location



Outdoor Unit:

